


PLAN

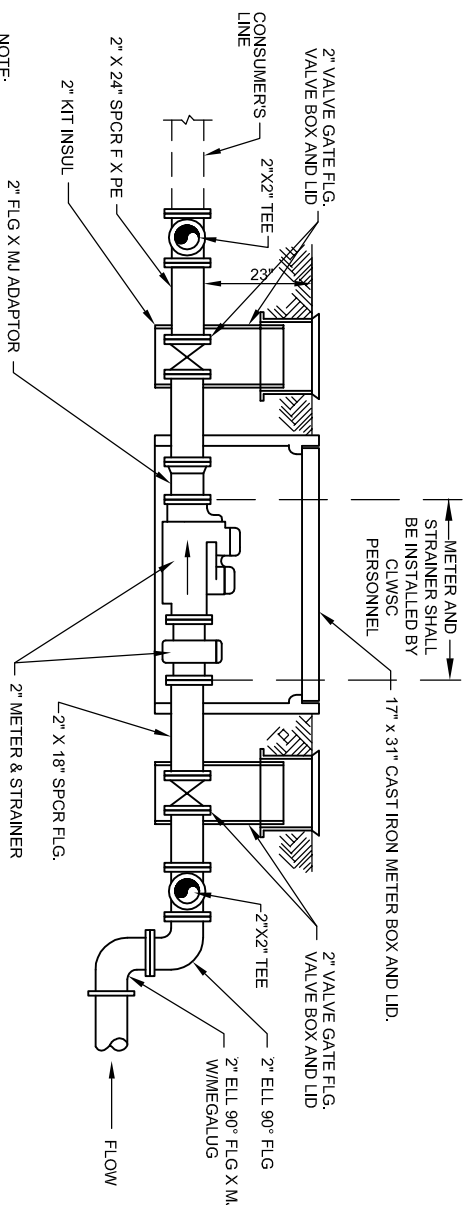

NOTE:
 1) USE TRAFFIC RATED BOXES FOR METER BOXES
 INSTALLED IN DRIVEWAYS OR SIDEWALKS.
 2) METER SUPPLIED BY CLWSC (PAID FOR BY CUSTOMER).

2" SERVICE DETAIL

STD. DWGS. AND SPECS. / SER-2 SCALE: N.T.S.

GENERAL NOTES:
 (1) FOR ADDITIONAL INFORMATION,
 SEE CANYON LAKE WATER SERVICE
 COMPANY'S STANDARD SPECIFICATIONS.

MH	UPDATE DRAWING	10-22-14			
MH	ADD PLAN & 2" BYPASS	09-01-12			
MH	UPDATE DRAWING	05-24-10			
MH	UPDATE DRAWING	04-26-10			
BY	REVISION	DATE	CK	AP	OPS

CLWSC
 CANYON LAKE
 WATER SERVICE COMPANY
 1399 Sattler Road
 Canyon Lake, Texas 78133
 (830) 964-3854

2" SERVICE

BY: JIW / MAHOMER	OPERATIONS / DATE
DATE: 02-11-09	ENGINEERING / DATE
SCALE: NONE	DIRECTOR OF ENGINEERING / DATE

REF. NOS.	DWG. NO.
	SER-2
SHEET: 1 OF 1	